

#### **Fabric and Metal Ducts**

# INSTALLATION AND MAINTENANCE FABRIC DUCTS KLIMAGIEL


### **CUSTOMER SERVICE**

Tel. +39 045 916672 Fax. +39 045 8344222

e-mail: klimagiel@klimagiel.it

Via Mezzacampagna 52 int. 37 37135 Verona



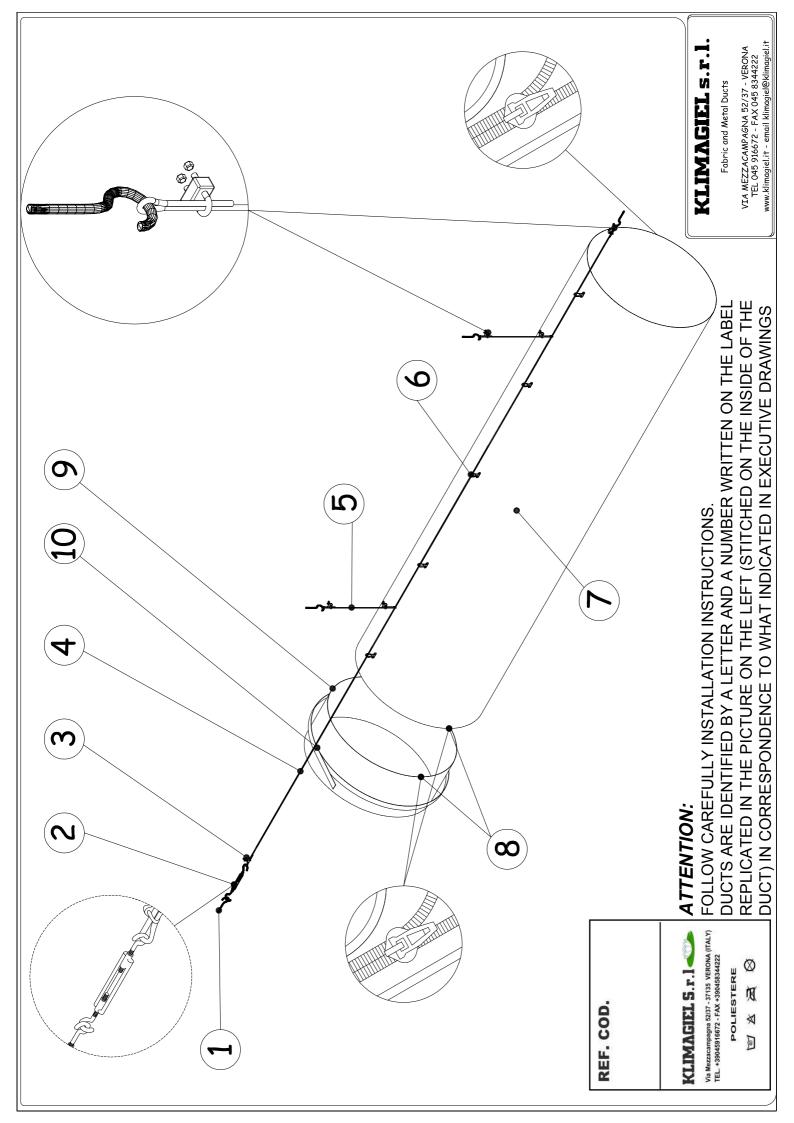

## INSTALLATION FABRIC DUCT WITH CIRCULAR SECTION AND SINGLE CABLE

On the previous page you can see: the assembling system, the components for proper installation and the fixing system. The components kit for specified versions is included in KLIMAGIEL ducts supply and it's identified by an itemized list.

**N.B.**: pressure caps and anchor screws for fixing at the ceiling <u>are not included</u> in KLIMAGIEL kit.

#### PLEASE NOTE

Before proceeding at the installation check:

- the entirety of all the components;
- the correspondence between components type and number you need for proper ducts assembling.

In case of doubts or inconsistency contact KLIMAGIEL® Customer Service.

#### ASSEMBLING INSTRUCTIONS

- 1. Fix the anchor screw at the ceiling **(1)** by means of pressure caps (not supplied by us). Except for different specific requests, they have to be placed 40 mm above superior duct edge (see the attached executive drawings).
- 2. Install the steel cable (4), making a buttonhole at both ends of the cable and then close them with specific clamps (3), as shown on page 2; hook the buttonhole directly at the supplied adjustable tie-rod (2); regulate the tie-rod in order to obtain the adequate tension on the steel cable; connect the tie-rod with the anchor screw installed at point 1.
- 3. Assemble vertical tie-rods **(5)** with cable and clamps as explain at the previous point, except for the adjustable tie-rod. We recommend to install vertical tie-rods with an axle spacing of 5,00 m.
- 4. Fit the fabric duct beginning (9) on the beginning plenum chamber and fasten it with the specific supplied steel collar (10).
- 5. In the end, connect the duct beginning (9) with the first duct segment (7) through the zip fastener and fasten it at the steel cable (4) through the fabric stripes ending with a clip (6).
- 6. Repeat the steps above for the installation of the whole duct system.

#### When installation is completed, check:

- the entirety and the solidity of anchor screws at the ceiling and at the wall;
- the proper cables tension while working;
- the duct seal at the beginning of the plenum chamber **(9)**. In particular, check if you have tighten well the steel collar **(10)**;
- the correct tightening of all zip fasteners connecting all duct segments.

#### WASHING AND MAINTENANCE INSTRUCTIONS

#### WATER WASHING

<u>ATTENTION:</u> Following maintenance instructions are meant for all type of fabric ducts, except for those made with fireproof fabric homologated Class 0 / M0 / A1.

Washing has to be made by hand or by washing machine following next procedure:

From 1 to 4 washing cycles using neutral washing powder or liquid detergent.

Every single washing cycle has to be made at a temperature not exceeding 45°C and it has to last for about 15 minutes.

For particularly dirty textiles we recommend a rinse after each washing cycle. Let dry at room-temperature.

On demand, our company offers cleaning service (for further information contact directly our technical or sales department).

#### WARNING! Only for Class 0 / M0 / A1

While assembling, you can find on the fabric parts some fiberglass filaments due to the manufacturing process (stitching and drilling).

These filaments could cause eyes or skin irritation in sensitive people.

Therefore we recommend the use of protective devices for hands while assembling.